



NOTE: AERATORS MAY BE INSTALLED NO MORE THAN 100' FROM AERATION TANKS

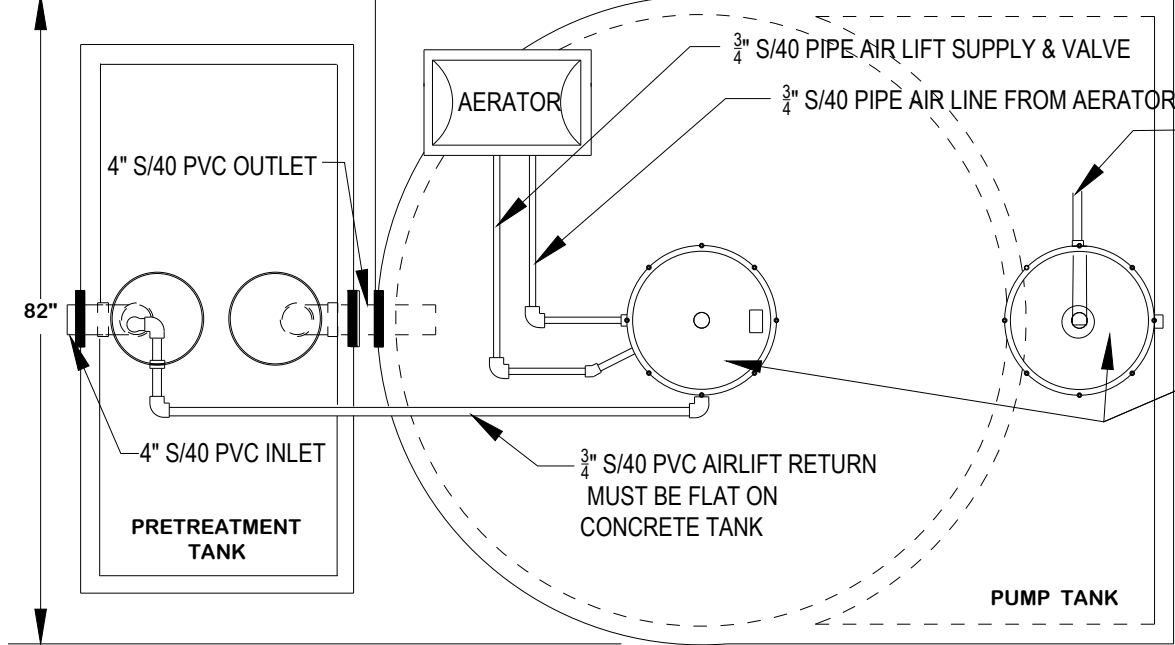

Patent Numbers:
 US 5,770,081
 US 5,785,854
 US RE39,203E
 US 7,513,944B2

DISCHARGE LINE TO DRAINFIELD
 20" ACCESS COVER
 CLEARSTREAM
 CONTROL PANEL

PLAN

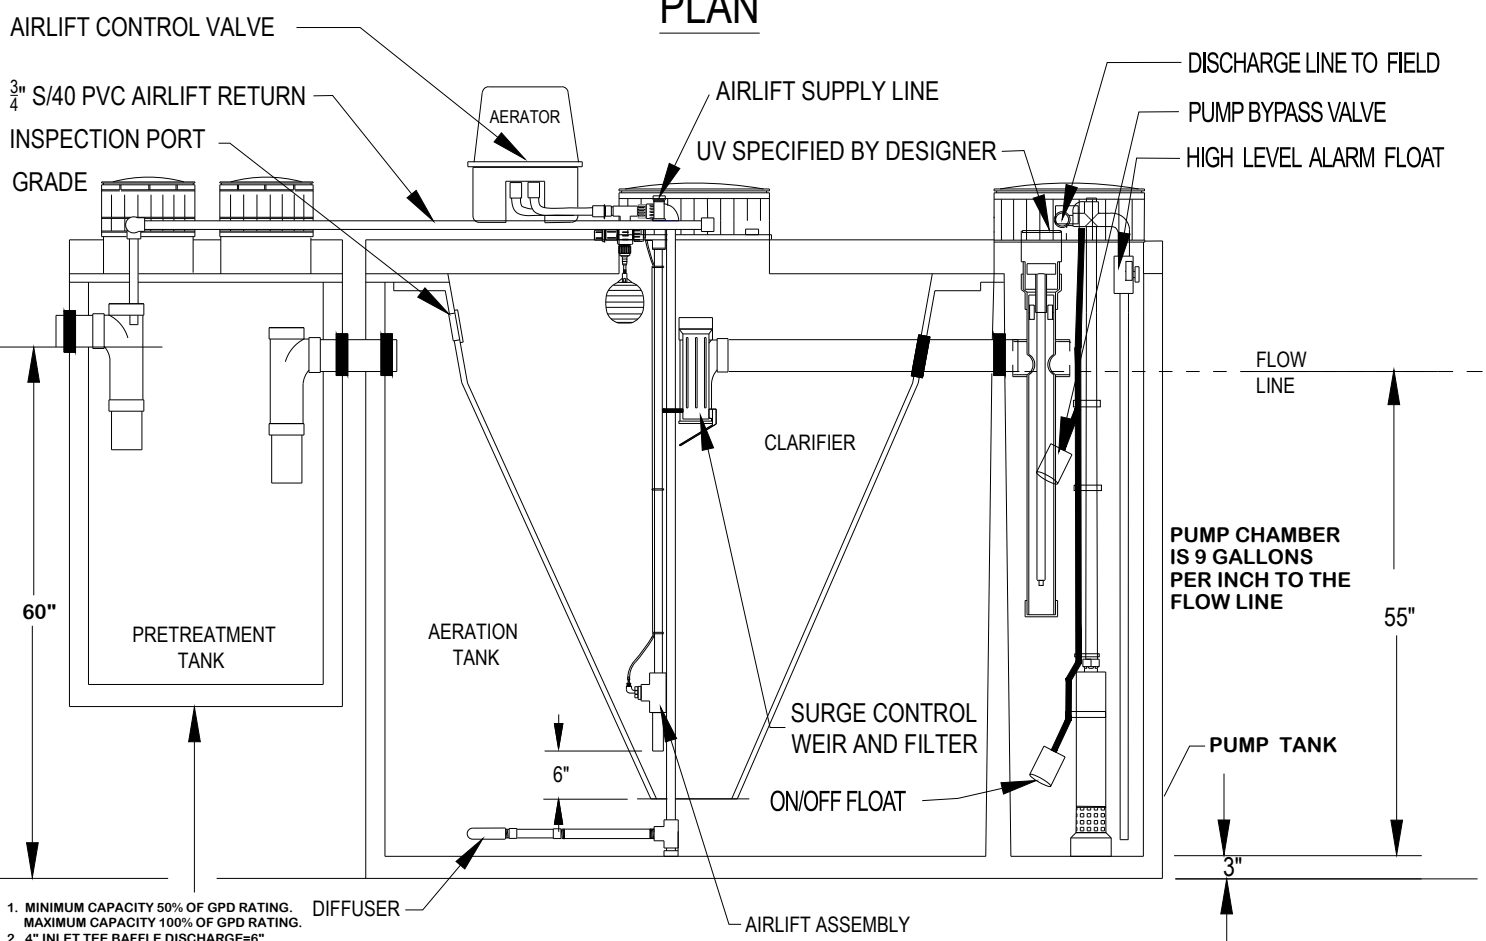

- 1. MINIMUM CAPACITY 50% OF GPD RATING. MAXIMUM CAPACITY 100% OF GPD RATING.
- 2. 4" INLET TEE BAFFLE DISCHARGE=6" BEYOND LIQUID LEVEL.
- 3. 4" OUTLET TEE BAFFLE INTAKE=25% TO 50% OF LIQUID DEPTH
- 4. INLET FLOW LINE MUST BE A MINIMUM OF 2" HIGHER THAN THE OUTLET FLOW LINE.

NOTES:
 1. DESIGNER TO SPECIFY PUMP AND FLOAT SETTINGS.
 2. CSUV1 IS OPTIONAL FOR STD 40 AND 245 APPLICATIONS AND REQUIRED FOR STD 350 APPLICATIONS

SECTION

PROPRIETARY AND CONFIDENTIAL THIS INFORMATION CONTAINED IN THE DRAWING IS THE SOLE PROPERTY OF CLEARSTREAM. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CLEARSTREAM IS PROHIBITED.	DRAWN BY LWM	DATE 8/01/2022	<h1 style="margin: 0;">600DAC W/ 500PUMP</h1>		
	REVISED	DATE			DWG. NO. 600DAC W500PUMP
	SCALE: NTS	SHEET 1 OF 1			